

210.52(C)(2) Island and Peninsulars

At least one receptacle outlet shall be provided for the first 0.84 m² (9 ft²), or fraction thereof, of the countertop or work surface

A receptacle outlet shall be provided for every additional 1.7 m² (18 ft²), or fraction thereof, of the countertop or work surface

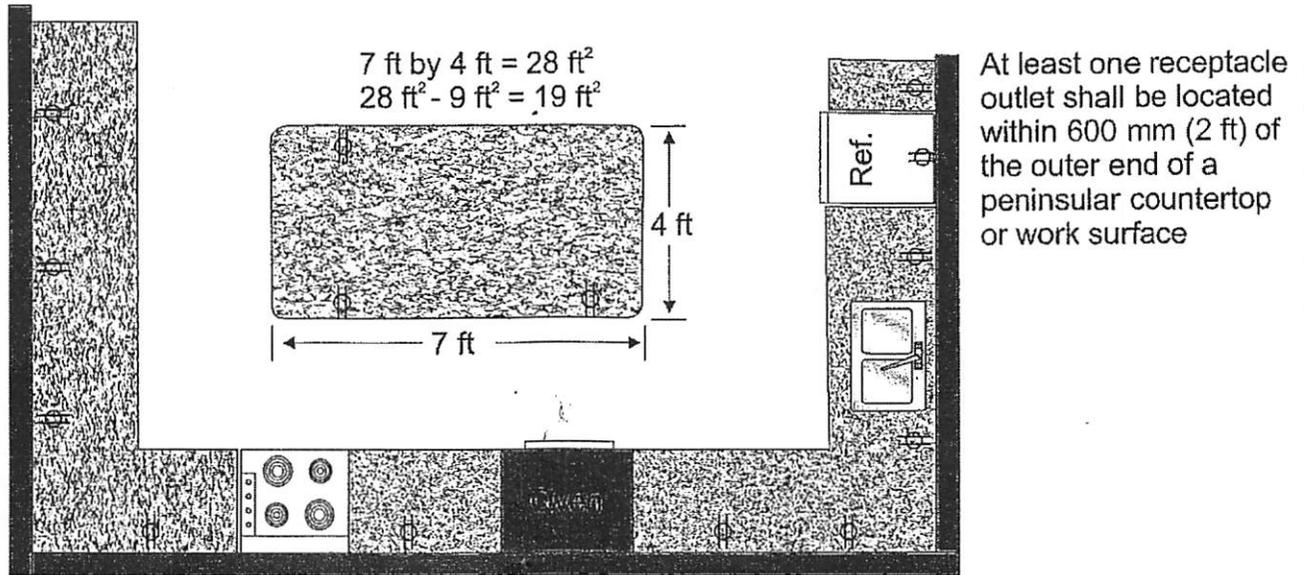


Figure 1. Illustration showing measuring to determine an island square footage.

210.52(C)(2) Island and Peninsulars

Examples of Minimum Number of Receptacle Outlets Required

Total Square Footage of Countertop	Minimum No. of Receptacle Outlets
8 sq. ft.	1
9 sq. ft.	1
More than 9 sq. ft. up to 27 sq. ft. [9 sq. ft. + 18 sq. ft. = 27 sq. ft.]	2
28 sq. ft. [first 9 sq. ft. (one), additional 18 sq. ft. (one) and addition fraction thereof (1 sq. ft.) (one)]	3
48 sq. ft. [48 sq. ft. - 9 sq. ft. = 39 sq. ft.] [39 sq. ft. ÷ 18 sq. ft. = 2.17 sq. ft.]	4

210.52(C)(2)(a) Island and Peninsular Countertops and Work Surfaces

At least one receptacle shall be provided for the first 0.84 m² (9 ft²), or fraction thereof, of the countertop or work surface.

A receptacle outlet shall be provided for every additional 1.7 m² (18 ft²), or fraction thereof, of the countertop or work surface.

Figure 2. Illustration showing a table for reference as to receptacle outlet requirements for islands.